



General information

All dimension in meter other detailed in the DRW sketch
 Mix ration of concrete should be in 1:2:6
 Mix ration of the plan concrete must be in 1:3:6
 Steel bar should be required to the specification of tensile test
 Clear cover slab not less than 50mm in the bottom
 Clear cover slab in the top not less than 25mm
 Concrete strength not less than 25mpa(25Nmm2)

inlet well Details

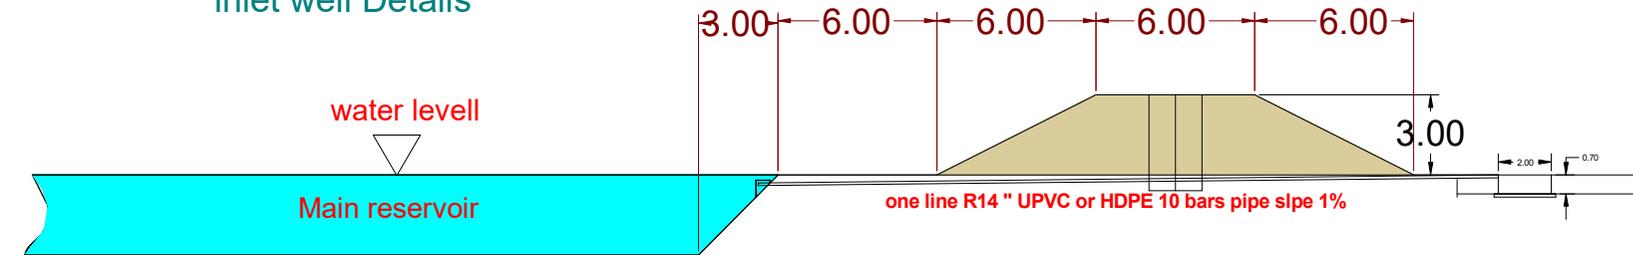

outlet well Details

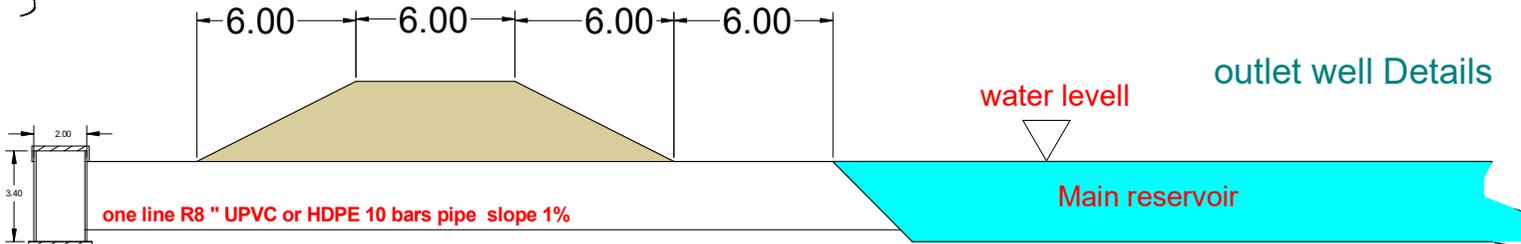

Project Name: GARNI HAFFIR Rehabilitation

Implementation Date: january 2022

Drawing by: Eng. Abubaker Abdullah

Client: ND – North Water sector

Donated by: UKaid fund

Approved by D. ELmutaz Eltayb

Scale 1:1

Dimensions by: meter

inlet and out let Details and embacements

Practical ACTION
 براكتيكال اكشن

